



3.

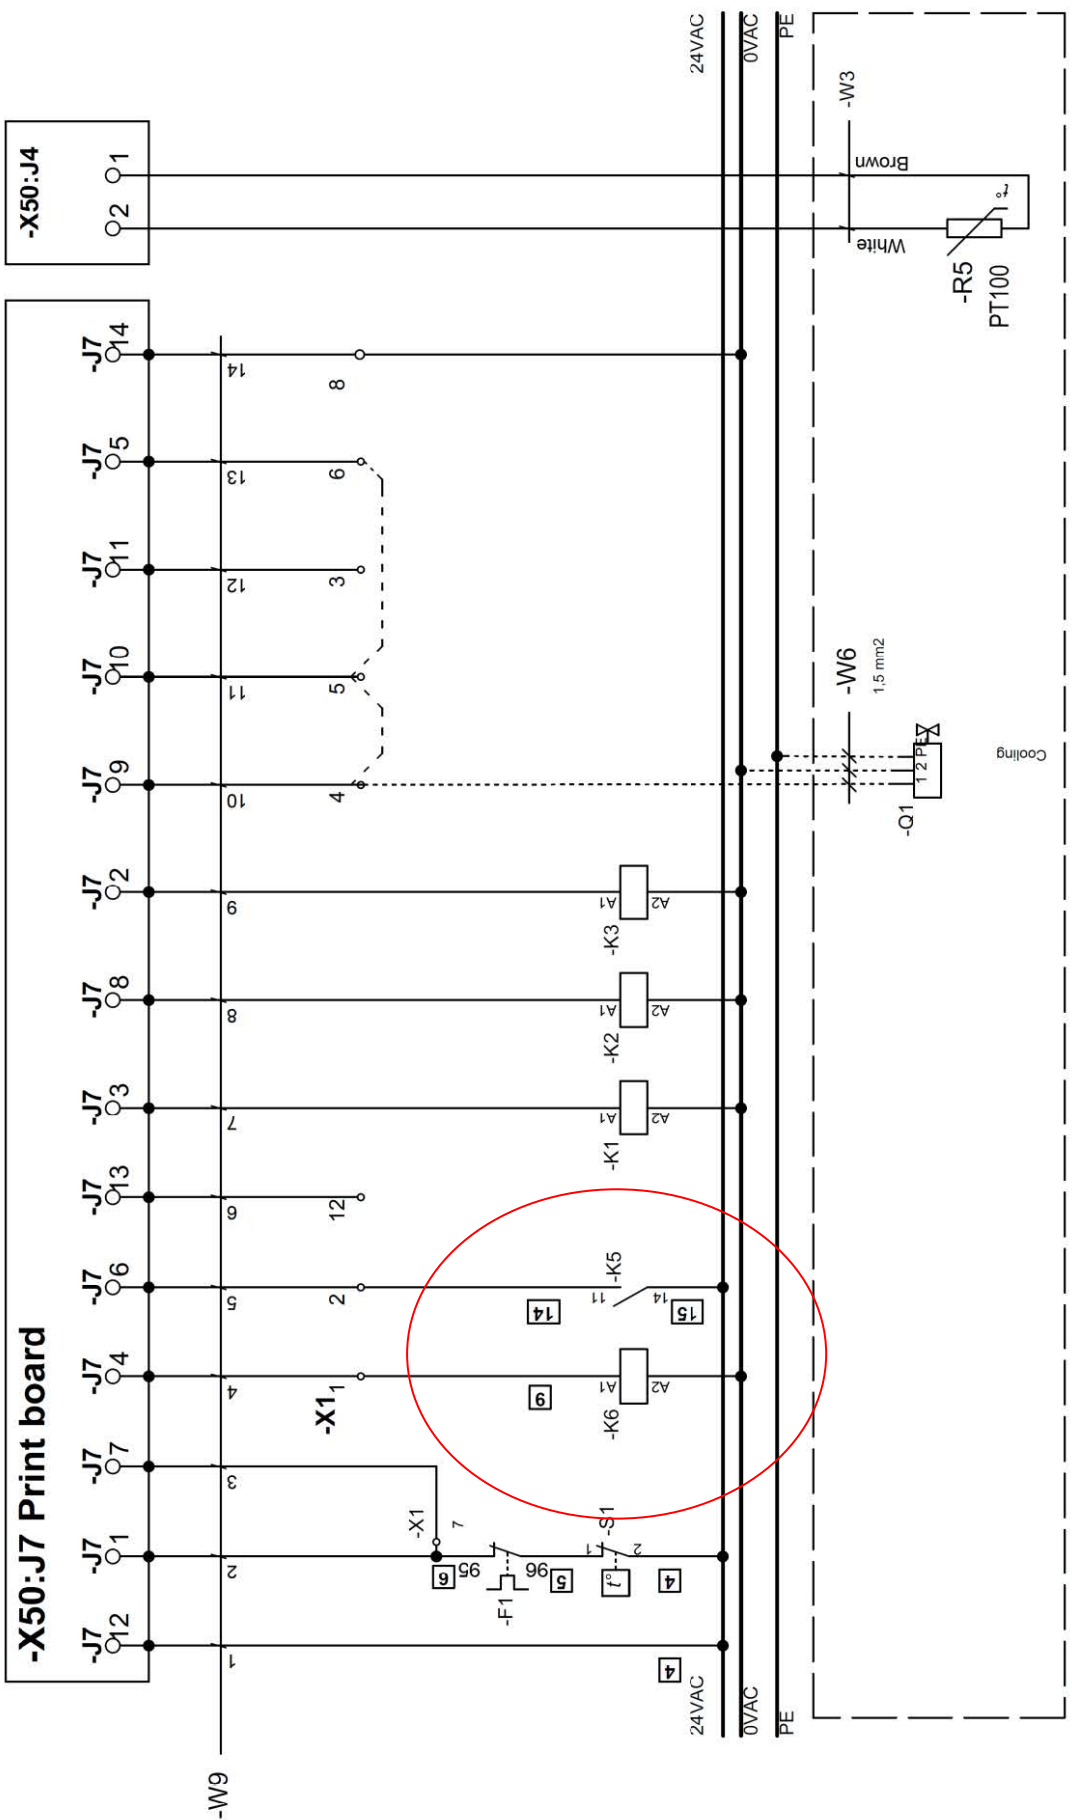

Out of electrical box

NOTE:
 K6 is only mounted when external alarm is mounted.
 K5 is only mounted when external Start/Stop is mounted.
 by direct cooling.
 There is a bridge mounted between X1: 4 and X1: 5

Projektitel: VA - External Start/Stop - Alarm	TegningsExternal Start/Stop - Alarm
Sidstitel: Control current	Sidst udskrevet: 17-09-2013 Side 1
Filnavn: VA-External Start/Stop-Alarm	Sidste rettelseres tid: 26-11-2014 Antal sider ialt: 2

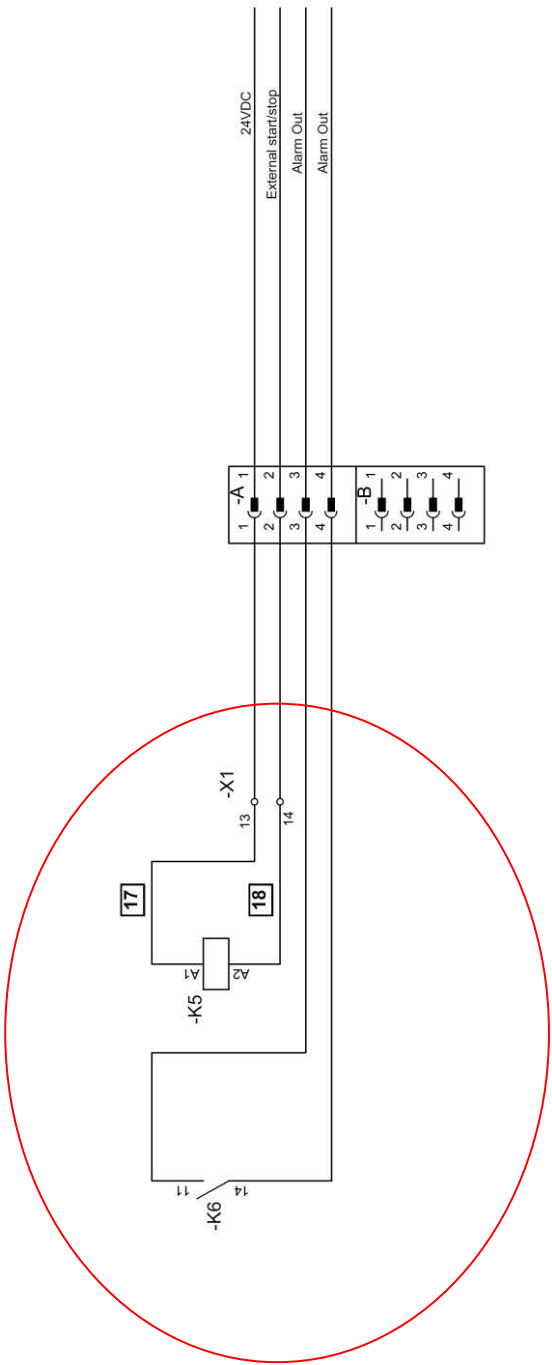

24VAC
 F41.24
 0VAC
 F41.24

NOTE:
 K6 is only mounted when external alarm is mounted.
 K5 is only mounted when external Start/Stop is mounted.

Projekttitel: VA - External Start/Stop - Alarm		Tegningens r-External Start/Stop - Alarm	
Sidetitel: Communication		Sidst udskrevet: 17-09-2013	
Filnavn: VA-External Start/Stop-Alarm		Sidste relløses id: 26-11-2014	
		Side	
		2	
		Antal sider ialt: 2	